

TECHNICAL DATA
MODEL KZN75R
HI-HARD SEVERE DUTY SLURRY PUMP – CHROME IRON / HI HARD VOLUTE
GENERAL DATA

MAX. FLOW: GPM (L/min)	655 GPM (2480 L/min)
MAX. HEAD: ft (m)	61' (18.6 m)
MAX. SUBMERSION DEPTH: ft (m)	65' (20m) or limited to length of power cord, Consult factory for deeper depths
PUMP TYPE	SLURRY HANDLING
SOLID SIZE: in (mm)	1" (25.4 mm)
STRAINER OPENING: in (mm)	1.375" (34.9 mm)
PUMP DOWN WATER LEVEL: in (mm)	12" (305 mm)
IMPELLER DIAMETER: in (mm)	8.97" (228 mm)
DISCHARGE SIZE	4" NPT-MALE (3" NPT-MALE OPTIONAL)
DISCHARGE CONNECTION (Optional)	3" or 4" HOSE BARB
PUMP WEIGHT, without cable: lbs (kg)	349 lbs (158.6 kg)
SHIPPING WEIGHT: lbs (kg)	402 lbs. (182.7 kg)

CONSTRUCTION / MATERIAL DATA

DUAL MECHANICAL SEALS	SILICON CARBIDE/SILICON CARBIDE
MOTOR HOUSING	CAST IRON
PUMP VOLUTE	DUCTILE IRON WITH INTERIOR HARDNESS COATING TO 1180 DPH(Rc 71)
WEAR PLATE	HI-CHROME
AGITATOR	HI-CHROME
IMPELLER	MULTI VANE, HI-CHROME
STRAINER/STAND	STEEL
LIP SEALS & O-RINGS	BUNA-N
ROTOR SHAFT	410 SS
EXTERNAL HARDWARE	304 SS
QTY. OIL IN SEAL CHAMBER	49 U.S. FL. OZ. (1450 C.C.)
BALL BEARING: PERM. LUBE. UPPER	6306
BALL BEARING: PERM. LUBE. LOWER	6308

ELECTRICAL / MOTOR DATA

MOTOR: TYPE, RATING HP	SUBMERSIBLE, 10 (CONTINUOUS DUTY)	
MOTOR RPM	1750	
MOTOR INSULATION CLASS	H	
MOTOR SERVICE FACTOR	1.15	
VOLTAGE ¹ - 3 PH, 60 Hz	460V	575V option
CURRENT F.L.A.	13	10.5
LOCKED ROTOR CURRENT (LRA)	77	55
MOTOR PROTECTION	THERMAL & AMP. OVERLOAD	
POWER CORD ² : GAGE; LENGTH	A.W.G. 10/5; 50' (15.2m), SOOW	
MAXIMUM LIQUID TEMPERATURE	104°F (40°C)	
SEAL LEAK DETECTOR ³ (OPTIONAL)	Seal Minder®; MOISTURE SENSING PROBE	

1- Available in other voltages (and in 50 Hz).

2- Changed to 5 lead cord on mid-2006.

3- Requires a seal fail circuit in control panel for warning signal.

©2020 Industrial Flow Solutions Operating, LLC. All rights reserved.


104 John W Murphy Drive

New Haven, CT. 06513, USA

Tel: (860)399-5937 - Fax: (860)399-7784



MODEL: KZN75R

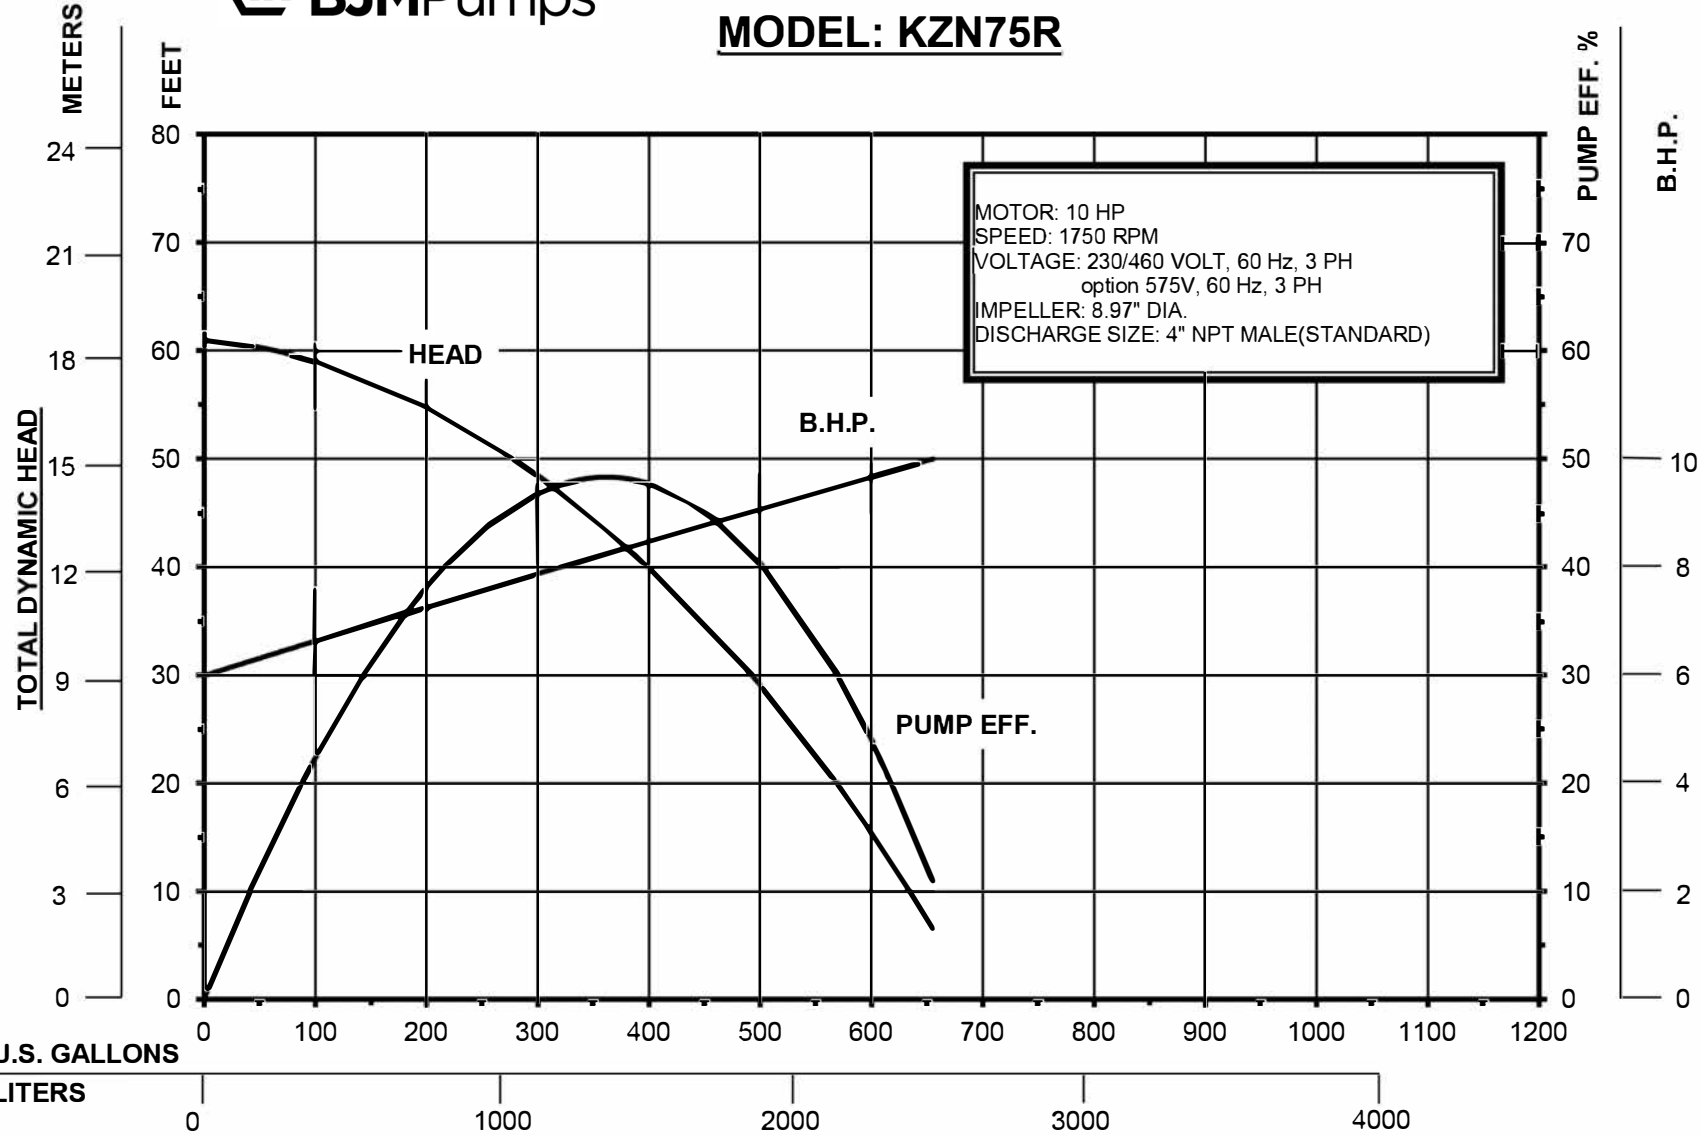

3/27/2020 supersedes priors

FLOW RATE PER MINUTE

SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE