


2 LO 0 L Q GHUXSO 6 [VWHEUHFV : L 20HG) ORDWV				
' Z J	DS-B02-010	5 HY	' DWI 8/17	6 HULAH 3


& R Q V W U X F W L R Q

0 R W R U ' H V L J Q	Induction	0 R W R U + R X V L Q J	Stainless Steel
0 R W R U 7 \ S H	Enclosed submersible	9 R O X W H	Cast Iron
, Q V X O D W L R Q & O	Class B	([W H U Q D O + D U G Z	Stainless Steel
0 R W R U 3 U R W H F V	Bi-metallic Thermal Switch	2 5 L Q J V	Nitrile (Buna N)
% D H W D O O L F 7 H F	120° C ± 5° C	0 R W R U 6 K D I W	Stainless Steel
0 D [) O X L G W H P S	104°F (40°C)	, P S H O O H U	Hytrel
8 S S H U 6 K H D D V	carbon/ceramic	/ R Z H U 6 K D I W 6 H D	Sic/Sic

& R Q J X U D W L R Q

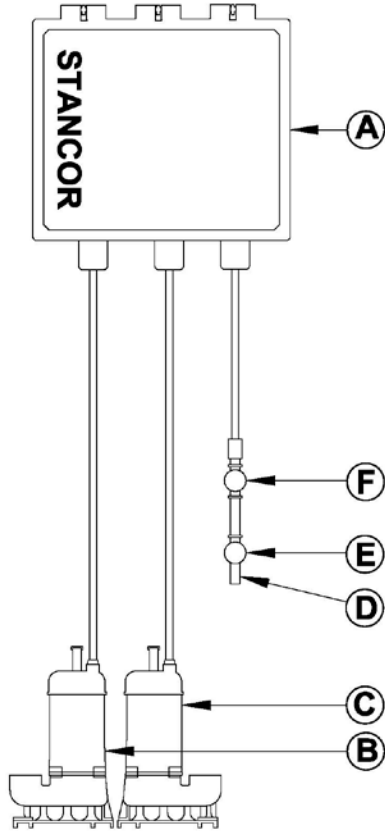

' L P H Q V L R Q V

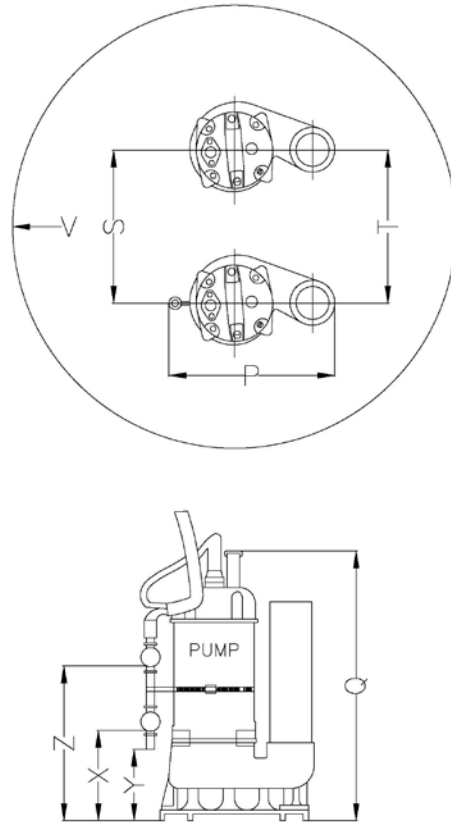

, W H	' H V F U L S W L R Q
\$	Control Panel
%	Pump A
&	Pump B
'	Sensor Probe
(ON Float
)	HIGH Level Float

, W H	' H V F U L S W L R Q
3	Pump with OM-300 Dist.
4	Dist. To handle
6	Min. Pump Dist.**
7	Min. Fitting Dist.***
9	Min. Sump ø
;	Pump ON
<	Pump OFF
=	High Alarm

6 H H 2 0
 & R Q I L J X U D W L R Q
 6 K H H W
 I R U V S H F L I I
 G L P H Q V L R Q V

0 L Q L P X P
 G L V W D Q F H U H T X L U H
 I R U S U R S H U S X P S
 S H U I R U P D Q F H

) L W W L Q J
 G L P H Q V L R Q V D U H
 E D V H G R Q
 \$ 1 6 , \$ 6 0 %